


# Underground Service

- 1) LOCAL ELECTRIC COOPERATIVE TO APPROVE METER BASE LOCATION.
- 2) SERVICE NEUTRAL, METER BASE MUST BE PERMANENTLY GROUNDED IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE.
- 3) CONDUIT TO BE FURNISHED AND INSTALLED BY CONSUMER, INCLUDING A CONDUIT PULL POLE.
- 4) METER BASE TO BE OBTAINED, INSTALLED AND ADEQUATELY SECURED BY CONSUMER.
- 5) CHANGES IN CONDUIT DIRECTION: MAXIMUM OF 2-90° ELECTRICAL ELBOWS OR ANGULAR EQUIVALENT.
- 6) TRENCH TO BE LEFT OPEN ON EACH END AND AT 2 INTERMEDIATE POINTS ALONG ROUTE FOR INSPECTION.
- 7) CONTACT UTILITY TO HELP INSTALL ELBOW IN EXISTING TRANSFORMER VAULT.



**IMPORTANT:** SHOULD TRENCH LENGTH EXCEED 100' OR SERVICE ENTRANCE SIZE BE LARGER THAN 200 AMP, CONSULT YOUR LOCAL ELECTRIC COOPERATIVE FOR SPECIAL DESIGN.

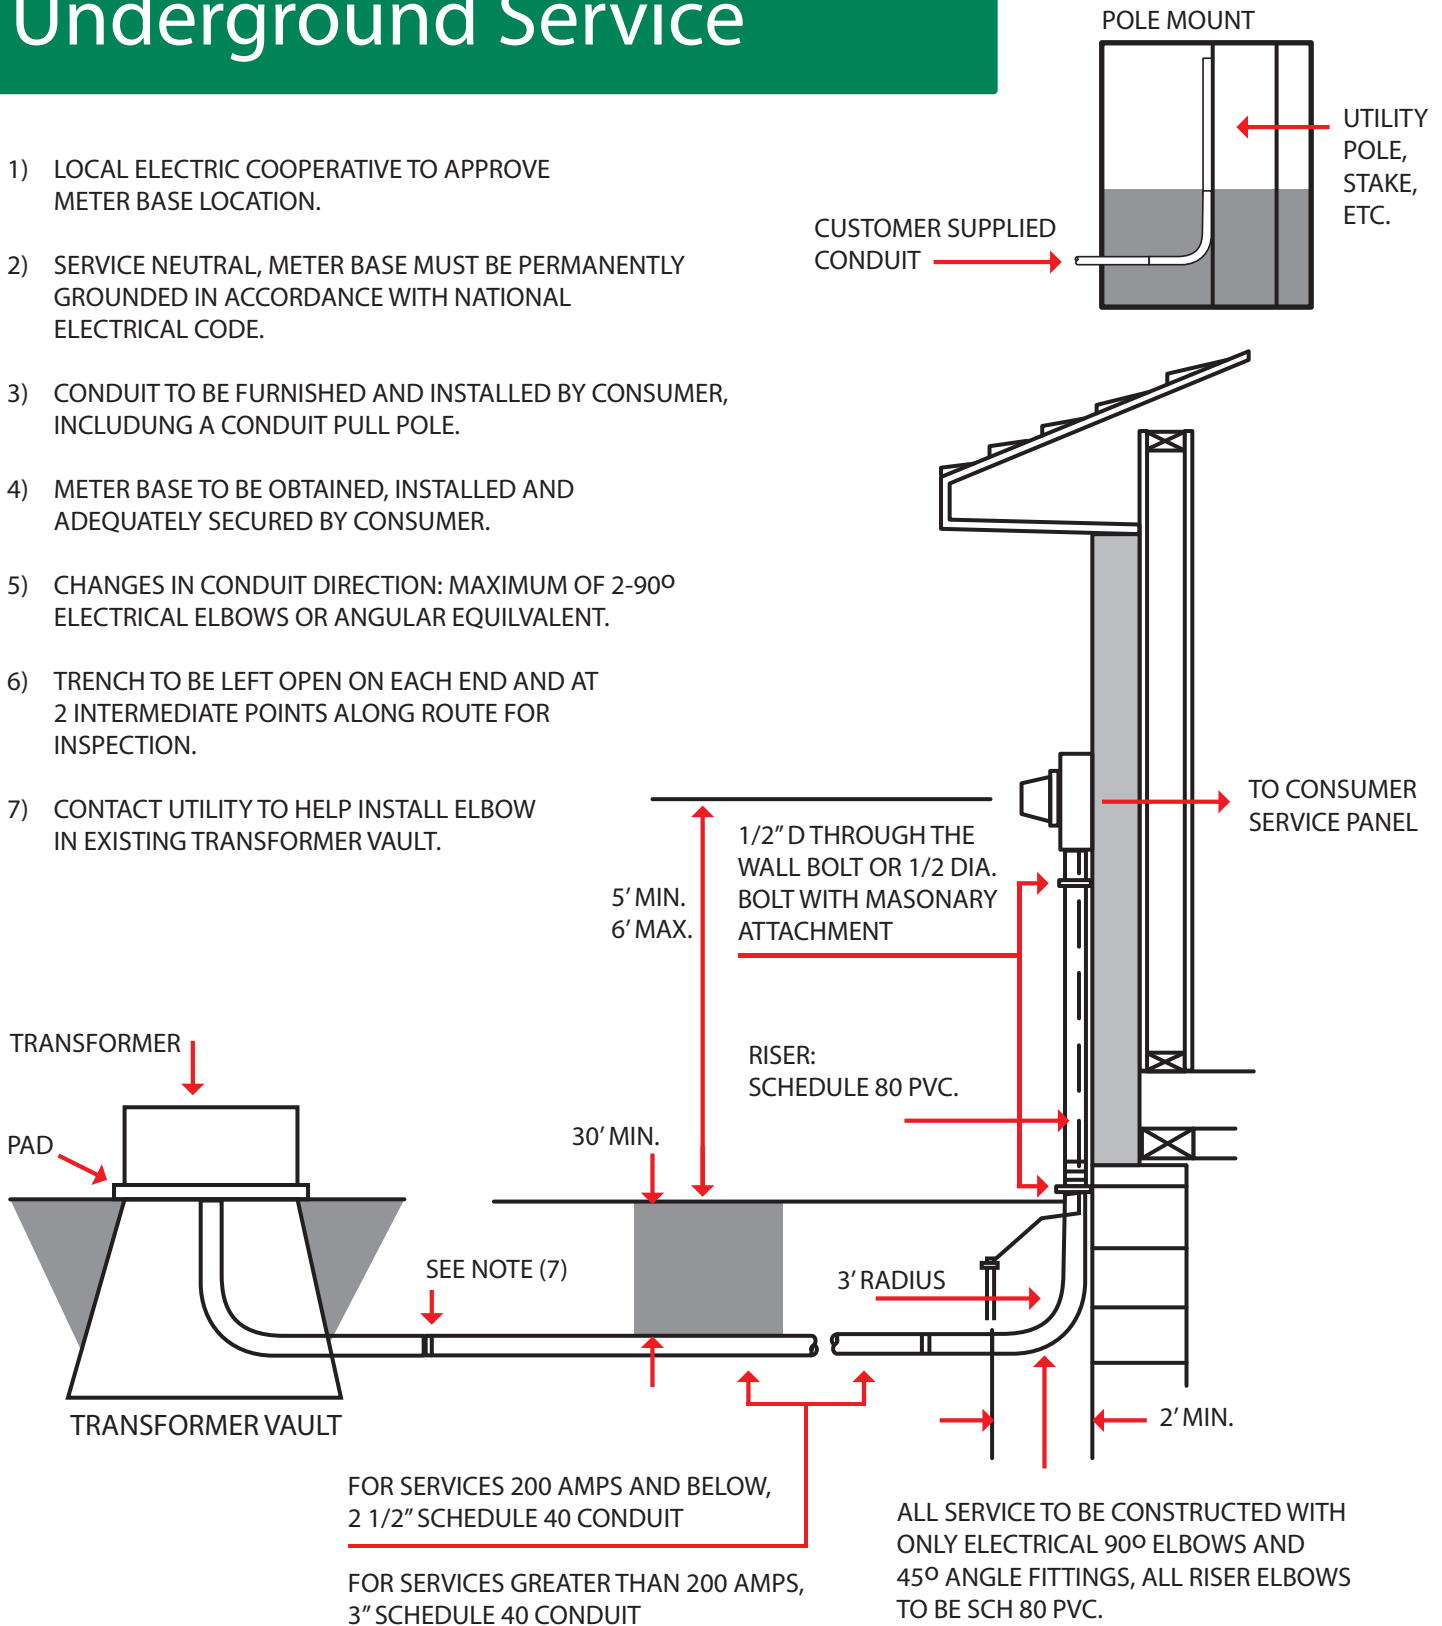

**Shelby Energy Cooperative**

® A Touchstone Energy® Cooperative 